



Design No. XR618
BYBU.XR618
Fire-resistance Ratings - ANSI/UL 1709

[Page Bottom](#)

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
 - Authorities Having Jurisdiction should be consulted before construction.
 - Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
 - When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
 - Only products which bear UL's Mark are considered Certified.
-

BYBU - Fire-resistance Ratings - ANSI/UL 1709


[See General Information for Fire-resistance Ratings - ANSI/UL 1709](#)

Design No. XR618

December 28, 2012

Ratings — 1/2, 1, 1-1/2, 2, 2-1/2, 3, 3-1/2, And 4 Hr

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

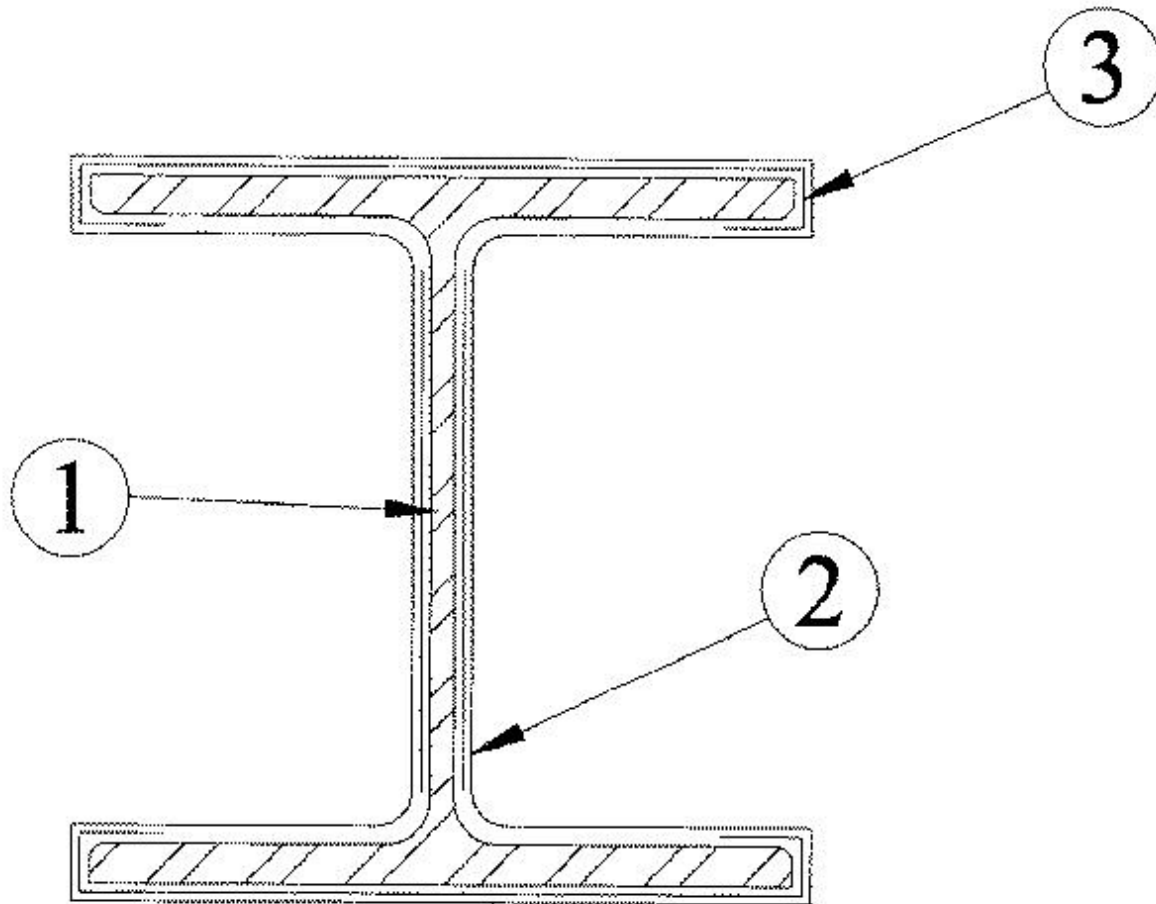

1. **Steel Column** — Min W10X49 wide flange steel column.

2. **Mastic and Intumescent Coating** — Spray applied in one or more coats to the thickness shown in the table below to column surfaces which must be free of dirt, loose scale and oil. Column surfaces to be primed. Coating lightly rolled after final coat with a paint roller.

Rating Hr	Min Thkns In.
1/2	0.078(+)
1	0.12
1-1/2	0.21
2	0.31
2-1/2	0.41
3	0.50
3-1/2	0.60
4	0.69

(+) Glass Fiber Mesh not required with this rating.

CARBOLINE CO — Types Thermo-Lag 3000-SP, Thermo-Lag 3000-P, Thermo-Lag 3000-SA, Thermo-Lag 3000-A and Thermo-Lag 3000-FC.

3. **Glass Fiber Mesh** — Nom 3/16 in. by 3/16 in. glass fiber mesh applied over each flange for the 1 through 4 hr ratings. In addition, the 1-1/2 hr through 3-1/2 hr shall have mesh placed in each web covering the whole web area. The mesh shall be placed at approximately mid-depth of the coating for the 1 and 1-1/2 hr ratings and at 0.12 in. for the remaining ratings.

4. **Top Coat** — Type Carboguard 1340 intermediate coat applied over mastic and intumescent coating at 0.002 in. thickness and Type Carbothane 133HB topcoat or Carbothane 133MC top-coat applied over intermediate coat at 0.003 in. thickness.

4A. **Top Coat** — As an alternate to Item 4, Type Carboguard 889 or Type Carbomastic 94 topcoat applied over mastic and intumescent coating (Item 2) at 0.010 in. thickness.

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2012-12-28

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

© 2014 UL LLC

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2014 UL LLC".