



Design No. XR705
BYBU.XR705
Fire-resistance Ratings - ANSI/UL 1709

[Page Bottom](#)

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
 - Authorities Having Jurisdiction should be consulted before construction.
 - Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
 - When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
 - Only products which bear UL's Mark are considered Certified.
-

BYBU - Fire-resistance Ratings - ANSI/UL 1709


[See General Information for Fire-resistance Ratings - ANSI/UL 1709](#)

Design No. XR705

October 14, 2013

Ratings — 1, 1-1/2, 2, 2-1/2, 3 and 4 Hr.

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

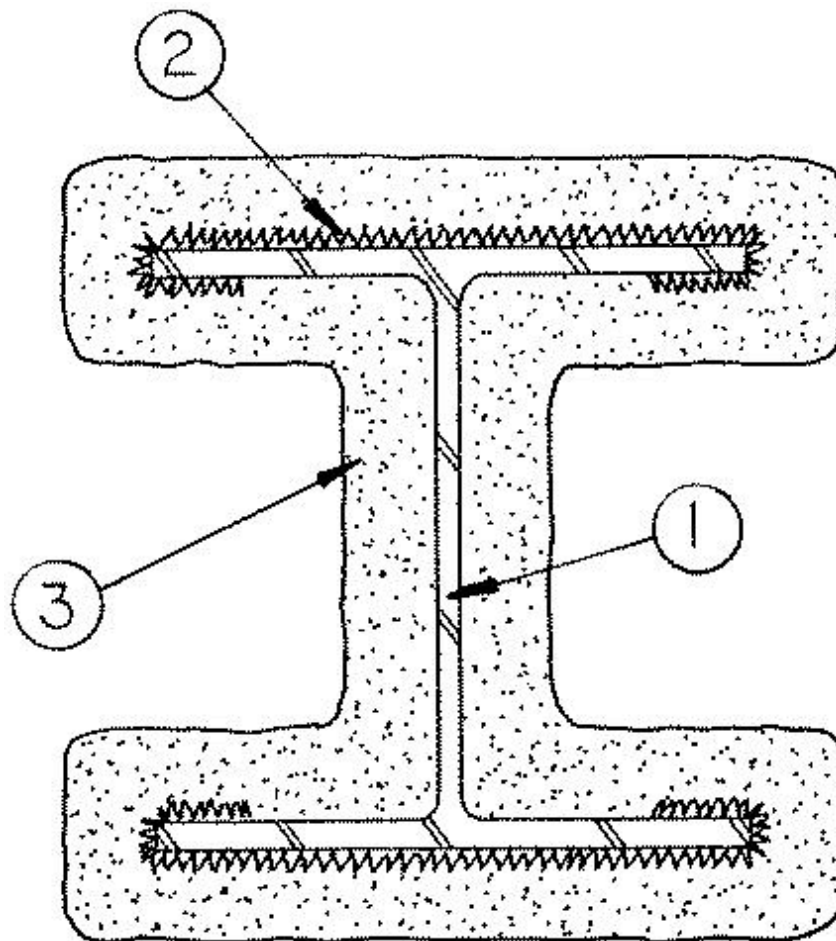

1. **Steel Column** — Minimum size W10x49.

2. **Metal Lath** — 3.4 lb/sq yd expanded steel metal lath placed around column flanges and secured by wrapping tightly around flanges a minimum of 1-1/2 in. toward the web of the column.

3. **Spray-Applied Fire Resistive Materials*** — See table below for required thicknesses. Where metal lath is present, thicknesses are measured to surface of lath, all other thicknesses are measured to steel surface. Prepared by mixing with water according to instructions printed on each bag of mixture. Mixture can be spray or trowel applied in one or more coats to the column and lath surfaces which must be clean and free of dirt, loose scale, and oil. For Type 240, minimum average density of 50 lb/pcf, with minimum individual value of 45 lb/pcf. The minimum average density of 40 pcf with a minimum individual density of 37 pcf for the Type 40. For method of density determination, see Design Information Section, Sprayed Material. Surface of material may be lightly finished with a trowel.

Rating Hr	Min Thkns In.
1	13/16
1-1/2	1-1/8
2	1-3/8
2-1/2	1-9/16
3	1-13/16
4	2-3/16

CARBOLINE CO — Types 40, 240.

CARBOLINE SOUTHEAST ASIA PTE LTD — Types 40, 240.

CARBOLINE (INDIA) PVT LTD — Type 40.

STONCOR MIDDLE EAST L L C — Type 40.

STONCOR SOUTH CONE S A — Types 40, 240.

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2013-10-14

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

© 2015 UL LLC

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2015 UL LLC".