

Issue Date: 08-05-2019  
Revision Date: 08-16-2024  
Renewal Date: 08-31-2025

**DIVISION: 07 00 00 THERMAL AND MOISTURE PROTECTION**  
**Section: 07 81 00 Applied Fireproofing**  
**Section: 07 81 23 Intumescent Fireproofing**

**REPORT HOLDER:**  
**Carboline Company**  
**350 Hanley Industrial Court,**  
**Brentwood, MO 63144**  
**(314) 644-1000**

**REPORT SUBJECT:**  
**FireFilm IV Intumescent Fire-Resistant Coating**

### 1.0 SCOPE OF EVALUATION

**1.1** This Research Report addresses compliance with the following Codes:

- 2024, 2021, 2018 *International Building Code*® (IBC)

NOTE: This report references the most recent version of the Codes noted. Section numbers in earlier version of the Code may differ.

**1.2** FireFilm IV has been evaluated for the following properties (see Table 1):

- Durability
- Fire-resistance
- Surface Burning Characteristics

**1.3** FireFilm IV has been evaluated for the following uses:

- Type I and II construction when installed in accordance with IBC Sections 603.1, item 21, and 1705.16.
- Fire-resistance-rated construction for up to a two-hour fire-resistance rating, for interior structural steel columns when constructed as described in Intertek Design Listing No. [CC/IF 120-02](#), or for up to a three-hour fire-resistance rating, for interior structural steel columns when constructed as described in Intertek Design Listing No. [CC/IF 180-04](#).

### 2.0 STATEMENT OF COMPLIANCE

FireFilm IV complies with the Codes listed in Section 1.1, for the properties stated in Section 1.2, and uses stated in Section 1.3, when installed as described in this report, including the Conditions of Use stated in Section 6.0.

#### 2.1 2024 IBC and IRC Evaluation Reports

The Intertek CCRR is an *Evaluation Report* for approval of an alternate material, design, or method of construction in accordance with Section 104.2.3.6.1 of the 2024 IBC and Section R104.2.2.6.1 of the 2024 IRC.

### 3.0 DESCRIPTION

**3.1** FireFilm IV is a water-based, thin-film, intumescent fire protective coating which is spray applied or painted with a brush or roller directly to primed steel surfaces.

### 4.0 PERFORMANCE CHARACTERISTICS

**4.1** Carboline FireFilm IV complies with the requirements of ICC-ES AC23 for use in interior locations.

**4.2** Carboline FireFilm IV has a Class A interior finish classification, when tested in accordance with ASTM E84.

**4.3** Fire Resistance ratings for use of FireFilm IV on steel structural members are described in Intertek Design Listing Nos. [CC/IF 120-02](#) and [CF/IF 180-04](#) (see Appendix A). Material thickness is specified in the Design Listing for each specific beam size.

### 5.0 INSTALLATION

#### 5.1 General:

FireFilm IV must be installed in accordance with the manufacturer's published installation instructions, the applicable Code, and this Research Report. A copy of the manufacturer's instructions must be available on the jobsite during installation.



5.2 Prior to application of Carboline FireFilm IV, the steel is sandblasted, then primed with Type Carbocoat 150 Universal Primer or with a compatible primer recommended by Carboline Company.

5.3 **Application:** Special inspections are required for application of Carboline FireFilm IV in accordance with IBC Section 1705.16. The thickness of the intumescent coating must be verified and determined using the methods prescribed in AWCI Technical Manual 12-B.

### 6.0 CONDITIONS OF USE

6.1 Installation must comply with this Research Report, the manufacturer’s published installation instructions, and the applicable Code. In the event of a conflict, this report governs.

6.2 Application is limited to interior locations.

6.3 Installation within plenums is outside the scope of this report.

6.4 Special inspections shall be provided in accordance with IBC Section 1705.16.

6.5 The Carboline FireFilm IV is manufactured under a quality control program with inspections by Intertek Testing Services NA, Inc.

### 7.0 SUPPORTING EVIDENCE

7.1 Reports of tests in accordance with ASTM E84-21a, Standard Test Method for Surface Burning Characteristics of Building Materials.

7.2 Data in accordance with the ICC-ES Acceptance Criteria for Sprayed Fire-Resistant Materials (SFRMS), Intumescent Fire-Resistant Coatings and Mastic Fire-Resistant Coatings

Used to Protect Structural Steel Members (AC23), dated August 2018.

7.3 Intertek Listing Report "[Carboline FireFilm IV](#)", on the [Intertek Directory of Building Products](#).

### 8.0 IDENTIFICATION

The Carboline FireFilm IV is identified on packaging with the manufacturer’s name (Carboline Company), address, the product name (FireFilm IV), storage and shelf-life, the Intertek Mark as shown below, and the Code Compliance Research Report number (CCRR-0317).



### 9.0 OTHER CODES

This section is not applicable.

### 10.0 CODE COMPLIANCE RESEARCH REPORT USE

10.1 Approval of building products and/or materials can only be granted by a building official having legal authority in the specific jurisdiction where approval is sought.

10.2 Code Compliance Research Reports shall not be used in any manner that implies an endorsement of the product by Intertek.

10.3 Reference to the <https://bpdirectory.intertek.com> is recommended to ascertain the current version and status of this report.

This Code Compliance Research Report (“Report”) is for the exclusive use of Intertek’s Client and is provided pursuant to the agreement between Intertek and its Client. Intertek’s responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Report. Only the Client is authorized to permit copying or distribution of this Report and then only in its entirety, and the Client shall not use the Report in a misleading manner. Client further agrees and understands that reliance upon the Report is limited to the representations made therein. The Report is not an endorsement or recommendation for use of the subject and/or product described herein. This Report is not the Intertek Listing Report covering the subject product and utilized for Intertek Certification and this Report does not represent authorization for the use of any Intertek certification marks. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek.






**TABLE 1 - PROPERTIES EVALUATED**

<b>PROPERTY</b>	<b>2024 IBC SECTION<sup>1</sup></b>
Types I and II Construction	603.1
Fire-Resistance-Rated Construction	703.2
Surface Burning	803.1
Special inspections	1705.16

<sup>1</sup> Section numbers may be different for earlier versions of the International Codes

## APPENDIX A

Carboline Global Inc.  
Design No. CC/IF 120-02  
Column  
FireFilm IV  
ASTM E-119-18a, UL 263 June 21, 2011, 14<sup>th</sup> Edition, CAN/ULC-S101-14  
Rating: See Table CC/IF 120-02

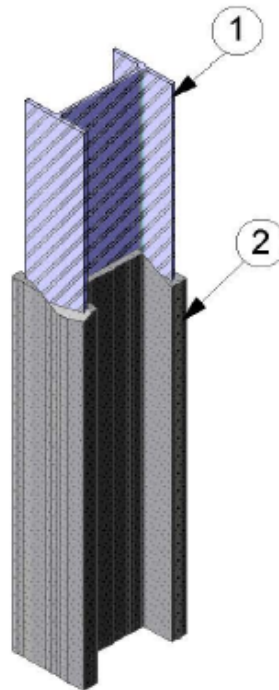

- 1. SOLID STRUCTURAL STEEL COLUMN:** Use solid steel sections, I-shape or W-shape, having nominal  $H_p/A$  or  $W/D$  section factors based on four-sided exposure. Prior to application of FireFilm IV (Item 1), column shall be prepared and coated with a compatible primer recommended by the manufacturer.
- 2. CERTIFIED MANUFACTURER:** Carboline Global Inc.

**CERTIFIED PRODUCT:** Intumescent Fireproofing

**CERTIFIED MODEL:** FireFilm IV


Spray or paint in one or more coats according to manufacturer's instructions to the required thickness specified in Table CC/IF 120-02.



HP/A	W/D	60 minutes		90 minutes		120 minutes	
		mm	in.	mm	in.	mm	in.
30	4.466	0.43	0.017	0.85	0.033	1.28	0.050
40	3.349	0.54	0.021	1.08	0.043	1.62	0.064
45	2.977	0.59	0.023	1.19	0.047	1.78	0.070
50	2.679	0.64	0.025	1.29	0.051	1.93	0.076
60	2.233	0.74	0.029	1.48	0.058	2.22	0.087
70	1.914	0.83	0.033	1.66	0.065	2.48	0.098
80	1.675	0.91	0.036	1.82	0.072	2.73	0.107
90	1.489	0.91	0.036	1.94	0.076	2.98	0.117
100	1.340	1.03	0.040	2.09	0.082	3.16	0.124
110	1.218	1.14	0.045	2.22	0.087	3.30	0.130
120	1.116	1.24	0.049	2.33	0.092	3.42	0.135
130	1.031	1.32	0.052	2.42	0.095	3.52	0.139
140	0.957	1.39	0.055	2.50	0.098	3.61	0.142
150	0.893	1.45	0.057	2.57	0.101	3.69	0.145
160	0.837	1.50	0.059	2.63	0.104	3.77	0.148
162	0.827	1.51	0.059	2.67	0.105	3.83	0.151
165	0.812	1.52	0.060	2.72	0.107	3.92	0.154
170	0.788	1.54	0.061	2.80	0.110	4.06	0.160
175	0.766	1.56	0.061	2.88	0.113	4.20	0.165
180	0.744	1.57	0.062	2.95	0.116	4.33	0.170
185	0.724	1.59	0.063	3.02	0.119	4.45	0.175
190	0.705	1.60	0.063	3.08	0.121	4.56	0.180
195	0.687	1.62	0.064	3.14	0.124	4.67	0.184
200	0.670	1.63	0.064	3.20	0.126	4.77	0.188
205	0.654	1.65	0.065	3.26	0.128	4.87	0.192
220	0.609	1.61	0.063				
230	0.582	1.64	0.064				
240	0.558	1.67	0.066				
250	0.536	1.70	0.067				
260	0.515	1.72	0.068				
270	0.496	1.75	0.069				
280	0.478	1.77	0.070				
290	0.462	1.80	0.071				
300	0.447	1.82	0.072				
305	0.439	1.83	0.072				



Carboline Global Inc.  
 Design No. CC/IF 180-04  
 Column  
 Fire Film IV  
 ASTM E119, UL 263, CAN/ULC-S101  
 Rating: See Table CC/IF 180-04

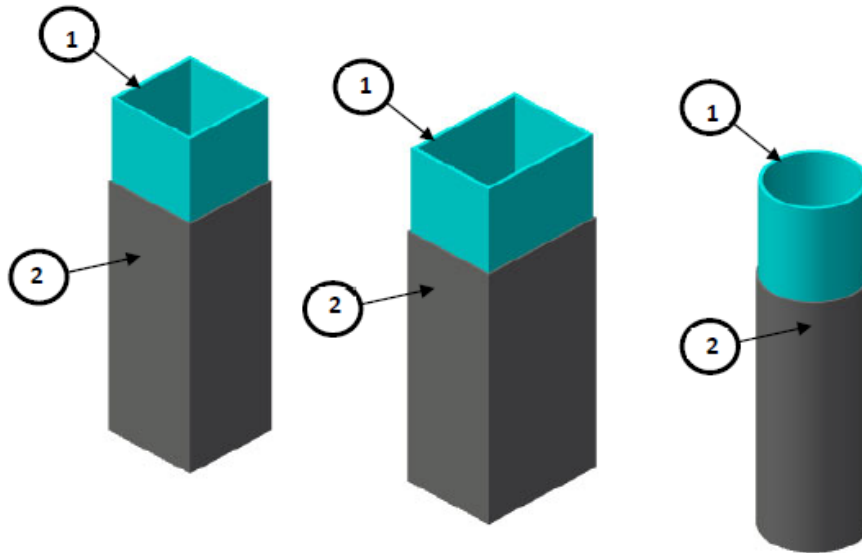

- HOLLOW STRUCTURAL STEEL COLUMN:** Use hollow square, rectangular, or circular steel sections, having nominal  $H_p/A$ , or  $A/P$  section factors based on four-sided exposure. Prior to application of FireFilm IV (Item 2), column shall be prepared and coated with a compatible primer recommended by the manufacturer.
- CERTIFIED MANUFACTURER:** Carboline Global Inc.

**CERTIFIED PRODUCT:** Intumescent Fireproofing

**CERTIFIED MODEL:** FireFilm IV

Spray or paint one or more coats according to manufacturer's instructions to the required thickness specified in Table CC/IF 180-04.

Table CC/IF 180-04

Hp/A	A/P	90 minutes		120 minutes		150 minutes		180 minutes	
		mm	in.	mm	in.	mm	in.	mm	in.
169	0.23	4.84	0.190	5.70	0.225	-	-	-	-
114	0.35	3.68	0.145	5.02	0.198	6.37	0.251	7.71	0.304
73	0.51	2.35	.093	3.60	0.142	5.26	0.207	7.00	0.275

